



Following are Gun-grade sealants which have been used for air plenum sealing and comply with the VOC content limits of LEED EQ Credit 4.1 Low Emitting Materials: Adhesive and Sealants. Deep penetrations must be controlled by the use of back-up filler material; see sealant manufacturer's recommendations for these requirements.


Seal Bond 93 Seam and Penetration Sealant;
VOC Content: <17g/L. www.seal-bond.com

SONOLASTIC® NP 1 Elastomeric Polyurethane Sealant,
VOC Content: 43g/L. www.BuildingSystems.BASF.com

Pecora AC-20 Acrylic Latex Sealant,
VOC Content: 31 g/L. www.pecora.com

RCD Corp. #20 Clear Acrylic Adhesive Sealant;
VOC Content: <10 g/L. www.rcdnastics.com

Where gaps occur between the edge of the access floor and fascia, apply duct or metal tape to seal joint prior to application of carpet.

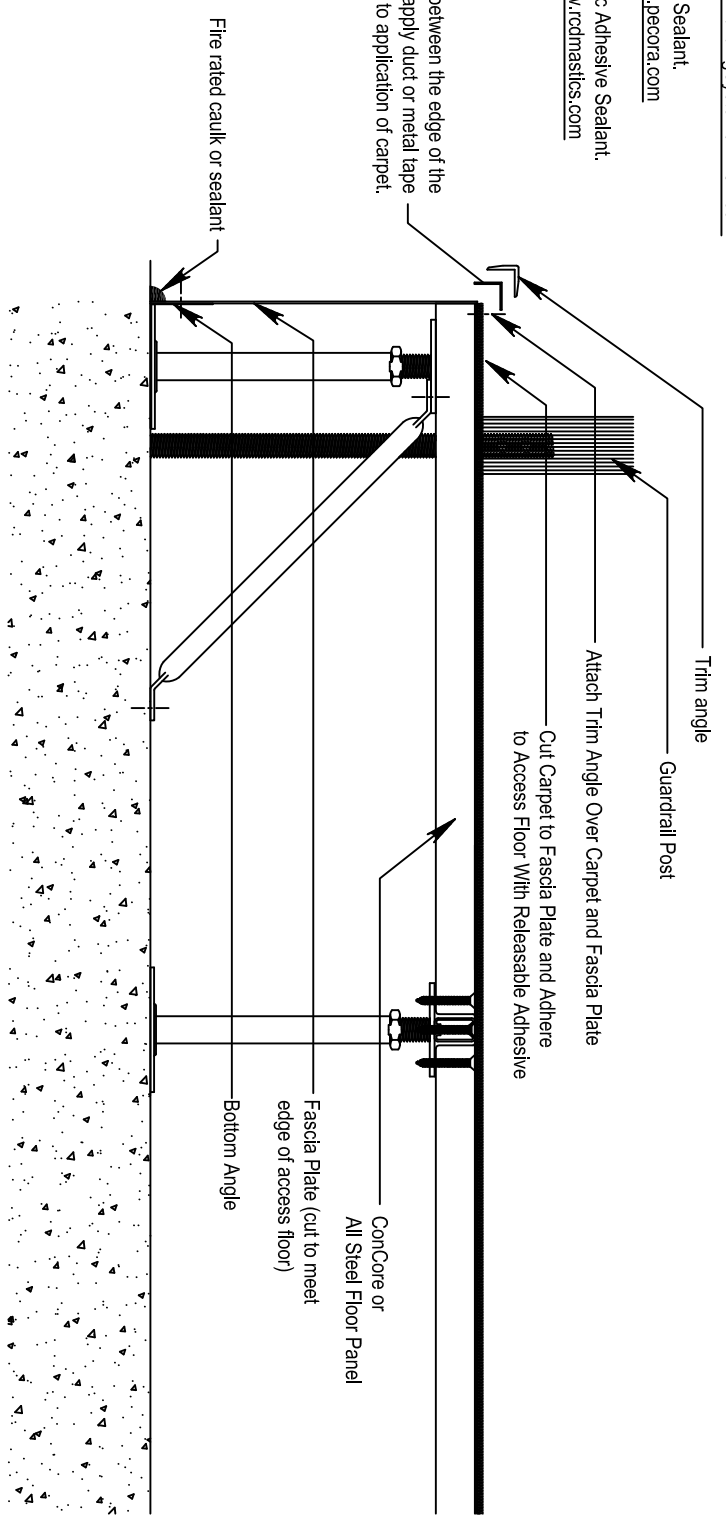

Access Floor Seal At Fascia / Exposed Edge